

## Control Stations


## BZC8050 Series Control Stations (Copper-free Aluminium Alloy)



- ◆ Explosion protection to
  - CENELEC
  - IEC
  - NEC
- ◆ Can be used in
  - Zone 1 and Zone 2
  - Zone 21 and Zone 22
  - Class I, Zone 1 and Zone 2
  - Class I, Division 2, Groups A, B, C, D
- ◆ Copper-free Aluminium Alloy enclosure, powder coated surface.
- ◆ Seven types of enclosure.

## ■ Catalogue number logic

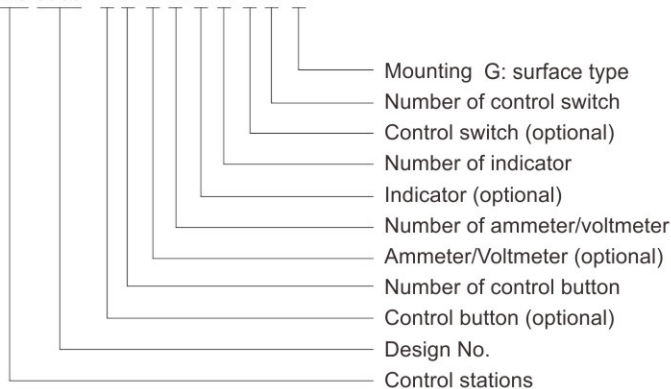BZC 8050 - A □ B □ D □ K □ □



## ■ Note



















1. Please refer to the Selection table on P4/33.
2. Please select internal components as below:
  - Selection table of BA8050 control button on P4/40~43 (Nominal contact is 1NO+1NC);
  - Selection table of BD8050 indicator on P4/44~46;
  - Selection table of BK8050 control switch on P4/47~52;
  - Selection table of BB8050 explosion-proof ammeter/voltmeter on P4/53~55;
3. Example: BZC8050-A2D2G
  - Components: Two control buttons, two indicators; surface type
  - Tech. Details: One control start button (40092B + 40090-1+40090-2, green, 1NO+1NC);
  - One control stop button (40092A+ 40090-1+40090-2, red, 1NO+1NC);
  - One indicator (40116B+40100B, green, 230V AC);
  - One indicator (40115B+40099B, red, 230V AC);
4. Special requirements on request.

Zones 1&amp;2; 21&amp;22

## Control Stations

## BZC8050 Series Control Stations (Copper-free Aluminium Alloy)

Selection table of control station BZC8050 (aluminium alloy)

Enclosure type	Components arrangement	Cable entries and direction	Ordering code	Enclosure weight (kg)
I		1-M25 x 1.5 Bottom entry	40079	0.65
II		1-M25 x 1.5 Bottom entry	40080	0.85
III		1-M25 x 1.5 Bottom entry	40081	1.10
IV	    	2-M25 x 1.5 Bottom entry	40082.....	3.75
V	  	1-M32 x 1.5 or 2-M25 x 1.5 Bottom entry	40083.....	6.50
VI	  	1-M40 x 1.5 or 2-M32 x 1.5 or 4-M25 x 1.5 Bottom entry	40084.....	9.00
VII	   	1-M40 x 1.5 or 2-M32 x 1.5 or 6-M25 x 1.5 Bottom entry	40085.....	13.70

## Control Stations

## BZC8050 Series Control Stations (Copper-free Aluminium Alloy)

## Technical data

## Control stations BZC8050 (aluminium alloy)

## Explosion protection

Global (IECEX)

IECEX CQM 11. 0029

Gas

Ex d e IIC T6 Gb

Europe (ATEX)

LCIE 09 ATEX 3099

Gas and dust

⊕ II 2 G Ex d e IIC T6 Gb

⊕ II 2 D Ex tb IIIC T80°C Db IP65

## Certificates

IECEX; ATEX; CU-TR

## Conformity to standards

EN 60079-0, EN 60079-1, EN 60079-7, EN 60079-31

IEC 60079-0, IEC 60079-1, IEC 60079-7

## Enclosure material

Copper-free Aluminium Alloy, powder coated surface

## Enclosure colour

Window grey (RAL7040)

## Exposed fastener

Stainless steel

## Rated voltage

Max. 415V AC

## Rated current

Main circuit current: 6A (for BZC8050-A2D2, BZC8050-A2B1)

16A (for BZC8050-K1)

10A (for others)

## Degree of protection

IP65

## Ambient temperature

-20°C~+55°C

## Internal&amp;external earthing

I, II, III: M4/M4; IV, V, VI,VII: M6/M6

## Components

1. Technical data of BA8050 control button on P4/40~43;

2. Technical data of BD8050 indicator on P4/44~46;

3. Technical data of BK8050 control switch on P4/47~52;

4. Technical data of BB8050 explosion-proof ammeter/voltmeter on P4/53~55;

## Cable entries

M□ x 1.5 plug, please see the Selection table on P4/33

## Cable gland (optional)

DQM-I (Ex e) is recommended. Please see P7/17~19

## Mounting

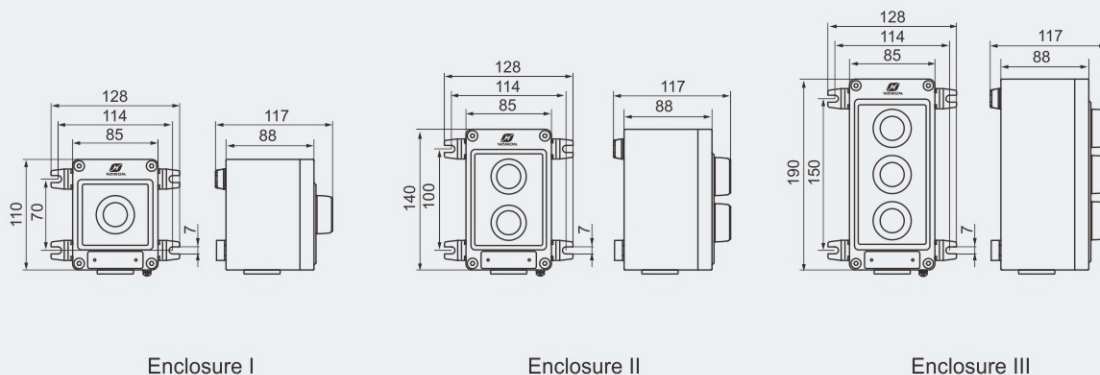
Surface type

## Note

Please specify the number and size of entries (applicable for surface type only);




## Dimension drawings (all dimensions in mm) - subject to alteration




## Control Stations

### BZC8050 Series Control Stations (Copper-free Aluminium Alloy)

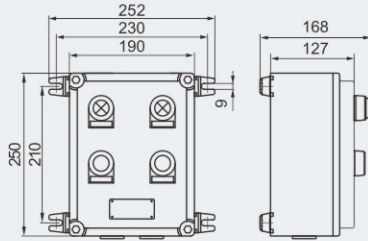
**Dimension drawings** (all dimensions in mm) - subject to alteration




Enclosure IV

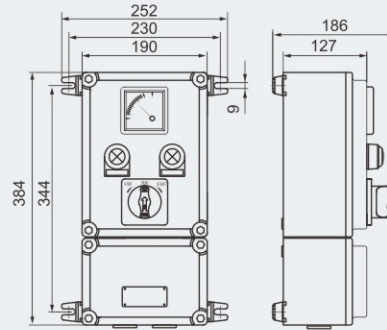

Enclosure V

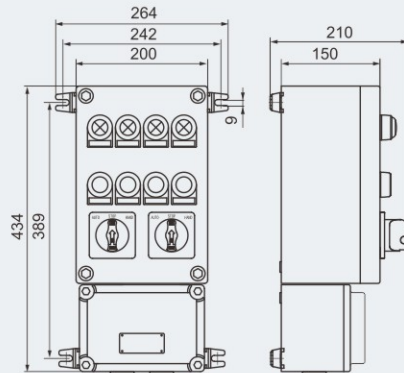

Enclosure VI

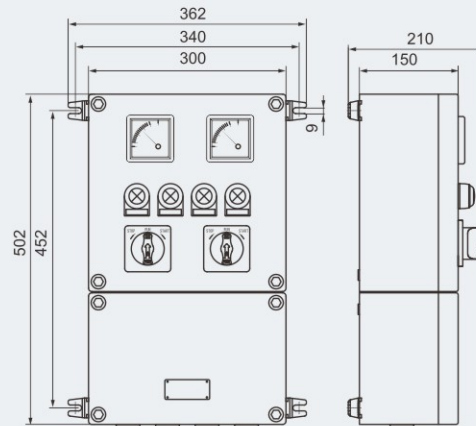

Enclosure VII